




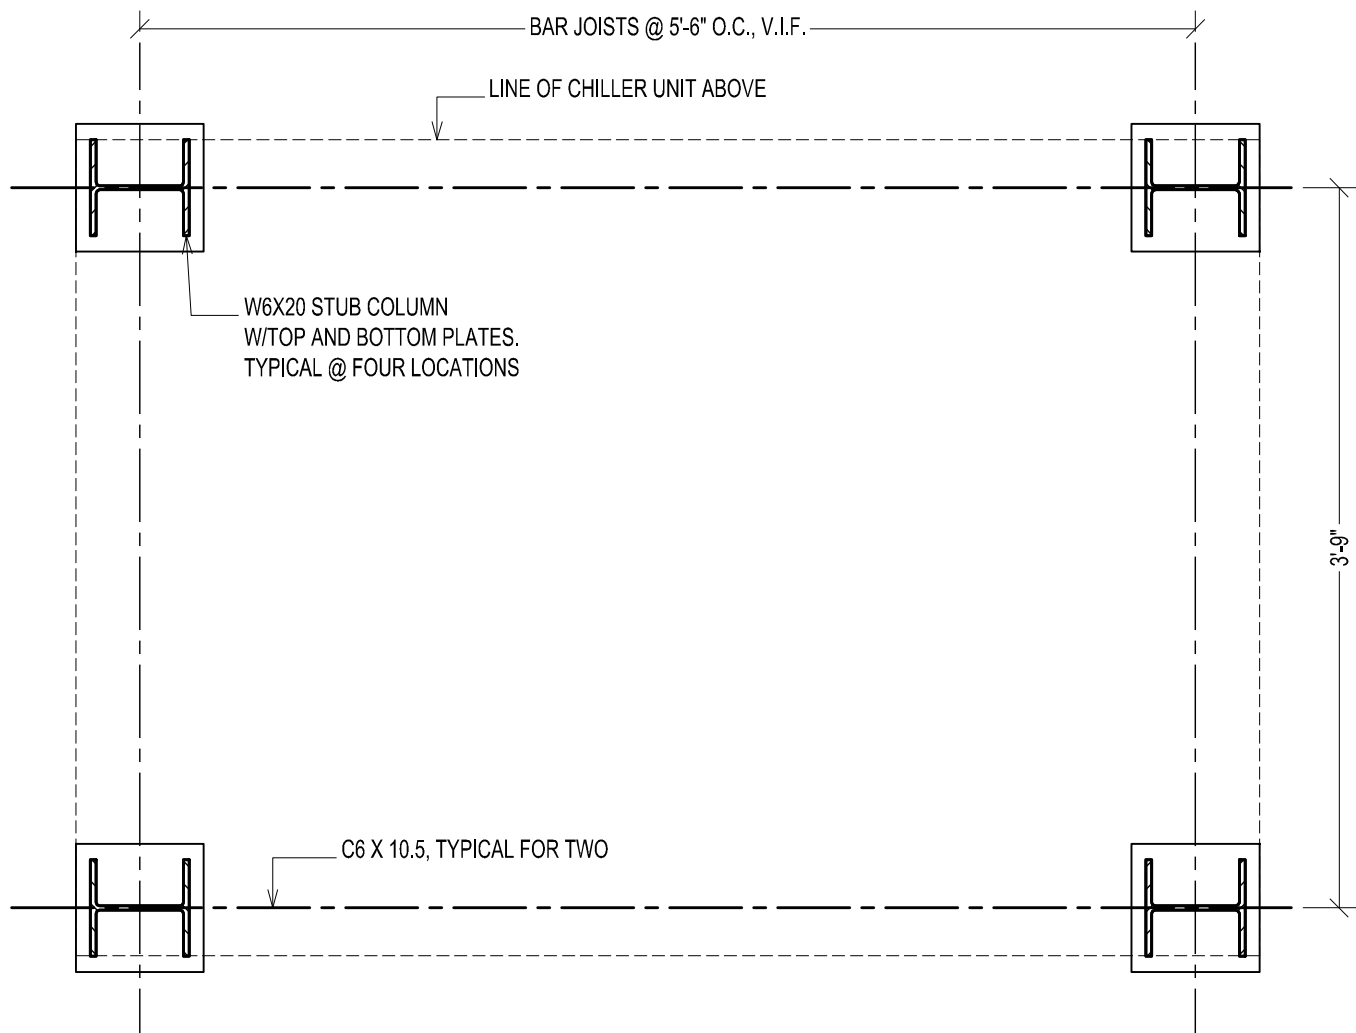


PLAN
1" = 1'-0"

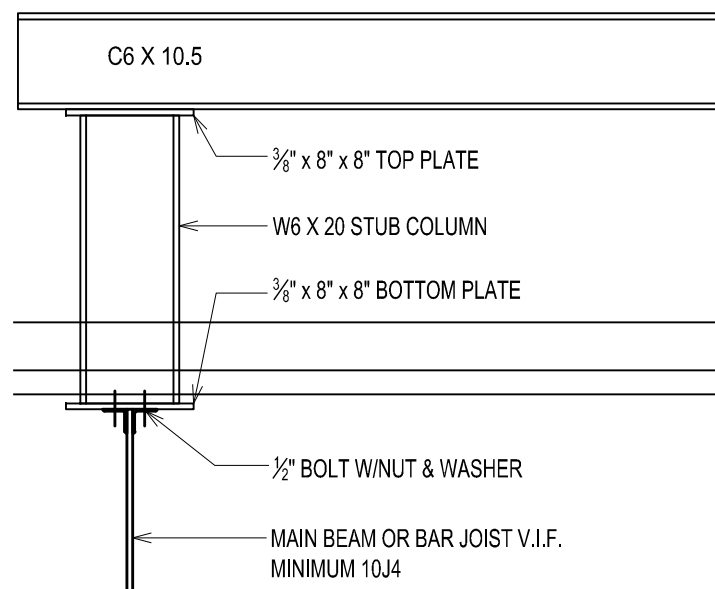

SECTION
1" = 1'-0"

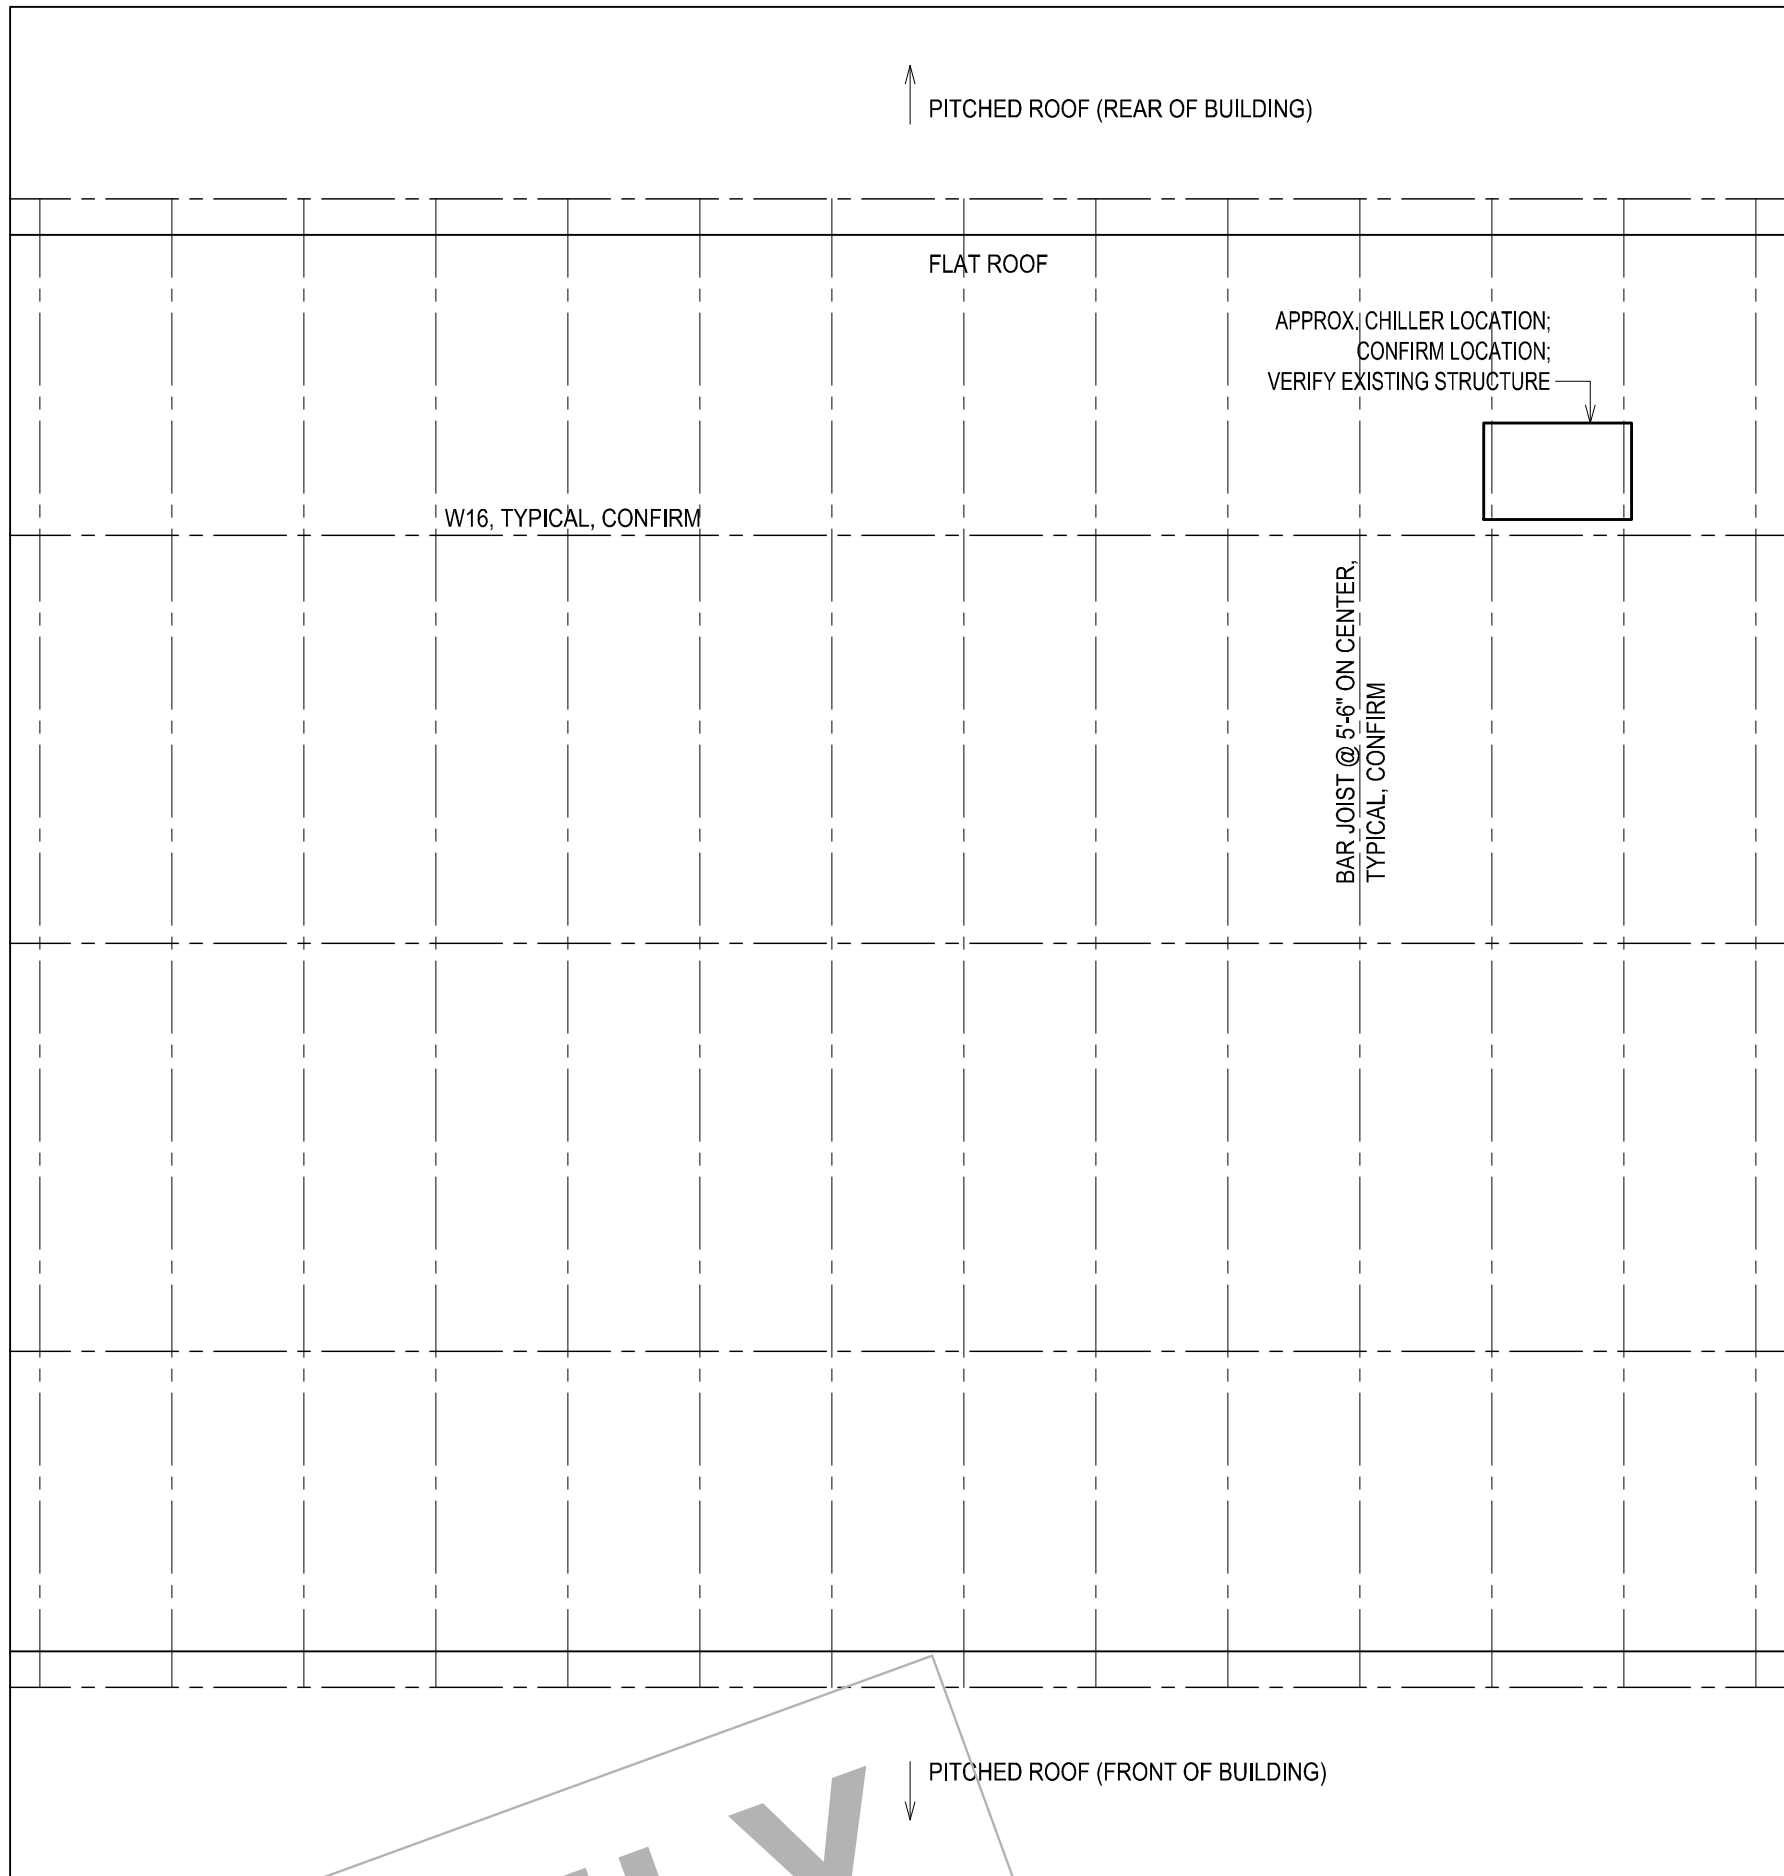

LAYOUT & LOCATION
 $\frac{1}{8}$ " = 1'-0"

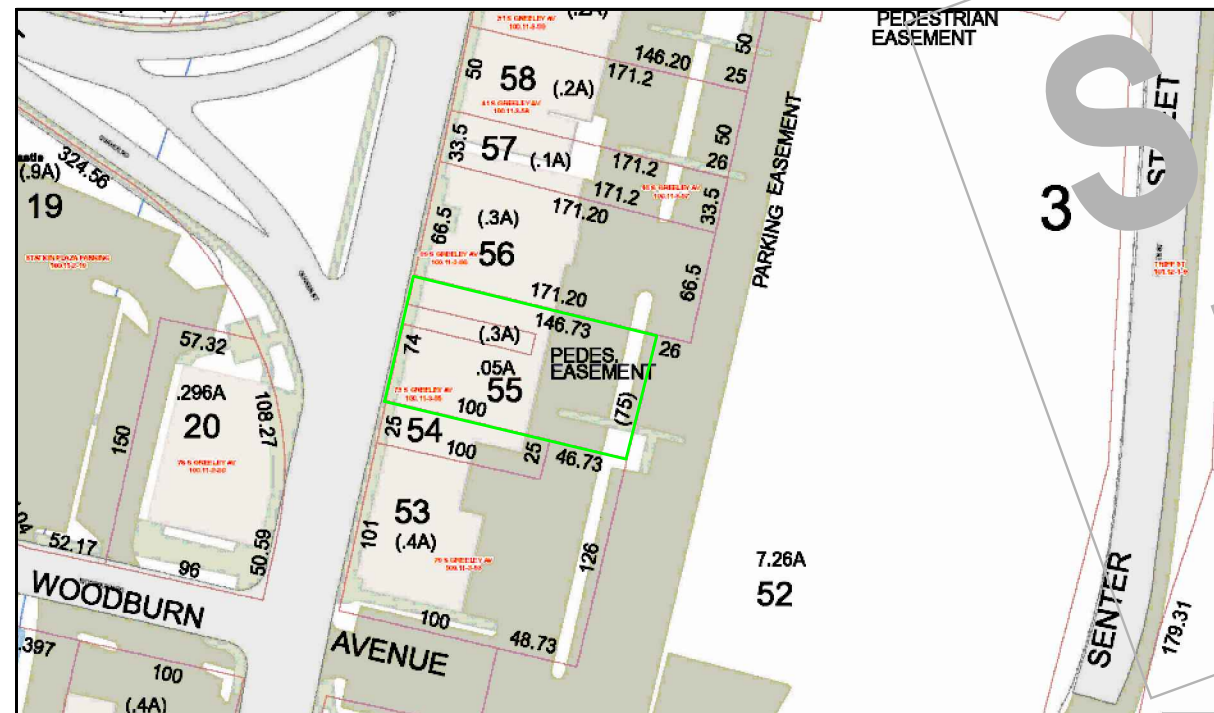

TAX/LOCATION MAP
WESTCHESTER COUNTY GIS

NOTES:
VERIFY ALL EXISTING STRUCTURE, MEMBERS AND LOCATIONS PRIOR TO CONSTRUCTION.
SUBMIT TO DRAWINGS FOR ENGINEER'S APPROVAL COORDINATE FIELD MEASUREMENT / SITE VISIT WITH ENGINEER.
ABRICATION AND ERECTION OF STRUCTURAL STEEL SHALL CONFORM TO THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION, ASD (LATEST EDITION).
ALL STEEL DETAILS AND CONNECTIONS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE AISC "SPECIFICATION FOR STRUCTURAL BUILDINGS" LATEST EDITION.
STEEL MATERIALS SHALL CONFORM TO THE FOLLOWING UNLESS OTHERWISE NOTED ON THE DRAWINGS:
ALL ROLLED SHAPES AND CHANNELS: ASTM A-572 OR A-992, MIN. YIELD STRENGTH OF 50 KSI
MISCELLANEOUS ANGLES: ASTM A-36, MIN YIELD STRENGTH OF 36 KSI
HOLLOW STRUCTURAL STEEL SECTIONS, (TUBES AND PIPES): ASTM A500 GRADE B, MIN YIELD STRENGTH OF 42 KSI FOR PIPES AND 46 KSI FOR TUBES.
ALL CONNECTION MATERIAL AND BASE PLATES SHALL CONFORM TO ASTM STANDARD A-36 (36KSI), WITH 50-KSI STEEL PLATE WHERE NOTED.
ALL BOLTS SHALL CONFORM TO ASTM A325 OR A490, NUTS SHALL CONFORM TO ASTM A563 AND WASHERS SHALL CONFORM TO ASTM A-F436.
ALL ANCHOR BOLTS/RODS SHALL CONFORM TO ASTM F-1554 GRADE 36 WITH WELD ABILITY SUPPLEMENT S1, UNLESS OTHERWISE NOTED.
ALL SHOP OR FIELD BOLTED CONNECTIONS, SHALL BE BOLTED CONNECTIONS USING 3/4 INCH DIAMETER A325 N BOLTS IN STANDARD HOLES, UNLESS SPECIFICALLY NOTED OTHERWISE.
OVERSIZED OR SLOTTED HOLES SHALL NOT BE USED FOR ANY CONNECTIONS UNLESS SPECIFICALLY INDICATED ON THE DRAWINGS OR APPROVED IN WRITING BY THE ENGINEER.
ALL WELDS SHALL BE PERFORMED BY QUALIFIED WELDERS IN ACCORDANCE WITH A.W.S. SPECIFICATIONS, LATEST EDITIONS. ALL WELDING ELECTRODES SHALL CONFORM TO A.W.S. A5.1 GRADE E-70. BARE ELECTRODES AND GRANULAR FLUX SHALL CONFORM TO A.W.S. A5.17, F70 A.W.S. FLUX CLASSIFICATION.

**GISMONDI
ARCHITECTS**
904 MEMORIAL DRIVE AUBREY, TX 76227
(914) 494-8943 MGISMO646@AOL.COM

Oliver Engineering, P.C.
Design - Permit Applications - Legalizations
Code Compliance - Project Supervision
188 North Main Street | Port Chester | NY 10573
(914) 774-9878 | www.proeng.nyc | vc@proeng.nyc

PROPERTY ADDRESS:

CHAPPAQUA, NY

S-B-L:

CLIENT:

DATE: 01.06.2022
ISSUE: FOR PERMIT

PROJECT NAME:
DUNNAGE FOR CHILLER

DRAWING NAME:
DUNNAGE

DRAWING NUMBER:
S.01

SCALE: AS NOTED
DATE: 01.06.2022

NOTE:
THIS DRAWING IS VALID FOR
CONSTRUCTION IF (AND ONLY IF)
A PERMIT IS ISSUED, BASED ON
THIS DRAWING, BY THE TOWN OF
NEWCASTLE